
# REBATE WIDTH

**ELEVATION** 

### **LEGEND**:

- 1. PRESSED STEEL ACOUSTIC FRAME.
- 2. ACOUSTIC PERIMETER SEAL TO BE FITTED AND FASTENED TO JAMBS AND HEAD BY INSTALLER ON SITE.
- 3. ACOUSTIC PERIMETER BULB SEAL TO BE FITTED AND FASTENED TO JAMBS AND HEAD BY INSTALLER ON SITE.
- 4. 1/2" HIGH STEPPED ACOUSTIC THRESHOLD 5" WIDTH, TO BE INSTALLED ON FINISHED FLOOR.

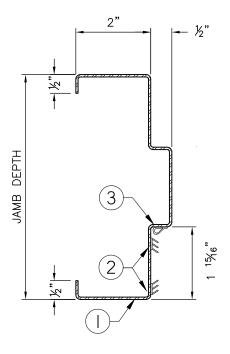



TYPICAL JAMB SECTION


NOTE: FRAME MUST BE INSTALLED AT FINISHED FLOOR HEIGHT. (DO NOT EMBED IN FLOOR)



# **AMBICO**

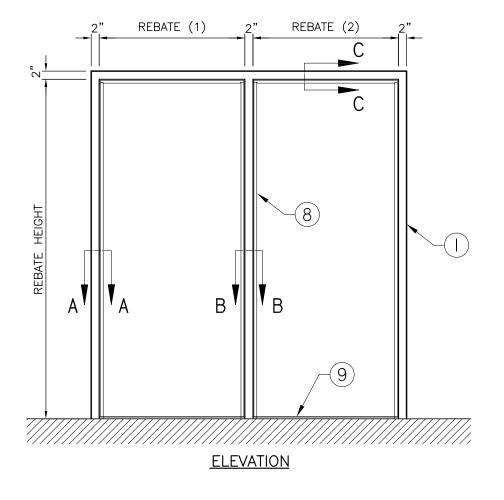


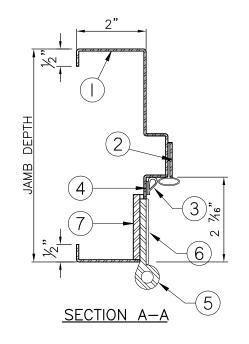



### **LEGEND:**

- 1. PRESSED STEEL ACOUSTIC FRAME.
- 2. FIRE RATED PERIMETER SYNPRENE SEAL SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 3. PERIMETER SMOKE SEAL, SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 4. INTUMESCENT STRIP, SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 5. HINGES, BY OTHERS.
- 6. INTUMESCENT HINGE PROTECTION , SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 7. HINGE REINFORCEMENT, FACTORY WELDED IN FRAME.
- 8. ACOUSTIC MULLION IS REQUIRED (FIXED OR REMOVABLE)
- 9. 1/2" HIGH STEPPED ACOUSTIC THRESHOLD 5" WIDTH, TO BE INSTALLED ON FINISHED FLOOR.



SECTION B-B

## NOTES: - FRAME MUST BE INSTALLED AT FINISHED FLOOR HEIGHT. (DO NOT EMBED IN FLOOR).




TYPICAL ACOUSTIC STEEL <u>PAIRED</u> FRAME AND PERIMETER SEALS FOR FIRE RATED WOOD DOORS — STC 43 TO 49 2012/03 2012/03/08


JOB NO:


SHEET: 1

OF: 1

# AMBICO LIMITED

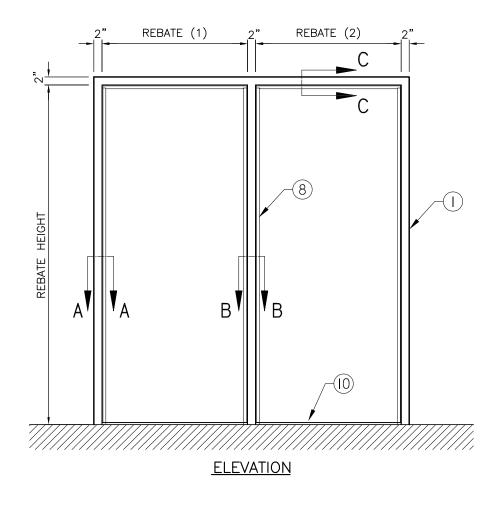

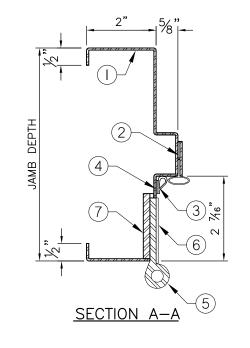




SECTION C-C

### **LEGEND**:

- 1. PRESSED STEEL ACOUSTIC FRAME.
- 2. FIRE RATED PERIMETER SYNPRENE SEAL SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 3. PERIMETER SMOKE SEAL, SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 4. INTUMESCENT STRIP, SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 5. HINGES, BY OTHERS.
- 6. INTUMESCENT HINGE PROTECTION , SHIPPED BY AMBICO, INSTALLED ON SITE BY OTHERS.
- 7. HINGE REINFORCEMENT, FACTORY WELDED IN FRAME.
- 8. ACOUSTIC MULLION IS REQUIRED. (FIXED OR REMOVABLE)
- 9. BRACKET AND ADDITIONAL PERIMETER SEALS TO BE FITTED AND FASTENED TO HEADER AT SITE.
- 10. 1/2" HIGH STEPPED ACOUSTIC THRESHOLD 5" WIDTH, TO BE INSTALLED ON FINISHED FLOOR.



NOTES :

- FRAME MUST BE INSTALLED AT FINISHED FLOOR HEIGHT. (DO NOT EMBED IN FLOOR).



TYPICAL ACOUSTIC STEEL PAIRED FRAME AND PERIMETER SEALS FOR FIRE RATED WOOD DOORS — STC 50 TO STC 51 2012/03/08

JOB NO:

SHEET: 1

OF: 1